




1 LIGHTING CEILING PLAN - LEVEL ONE - SEGMENT A
1/8" = 1'-0"

LIGHTING GENERAL NOTES

- SEE SHEET EL07-01 FOR GENERAL NOTES APPLICABLE TO THE ENTIRE DRAWING SET.
- REFER TO LIGHTING CONTROL CHART FOR MORE INFORMATION ON LIGHTING CONTROL SWITCH PLAN NOTES (CIRCLE NOTES - LE, LC, ETC.).

LIGHTING PLAN NOTES

- L1 INSTALL BOTTOM OF LUMINAIRE AT 10'-6" A.F.F. VERIFY EXACT INSTALLATION HEIGHT WITH ARCHITECT BEFORE INSTALLATION.
- L2 INSTALL BOTTOM OF LUMINAIRE IN THIS SPACE AT 9'-0" A.F.F. INSTALL LUMINAIRE TO AVOID MECHANICAL EQUIPMENT.
- L3 INSTALL LIGHTING DEVICE ON MULLION. WIRING FOR DEVICE TO BE RUN IN MULLION.
- L11 RECESSED LUMINAIRE IN ALL SPECIALTY CEILINGS SHALL BE INDEPENDANTLY SUPPORTED FROM STRUCTURE.
- L12 SWITCH(ES) AT THIS LOCATION TO OPERATE AS THREE-WAY SWITCH(ES).
- L13 SWITCH(ES) AT THIS LOCATION TO OPERATE AS FOUR-WAY SWITCH(ES).

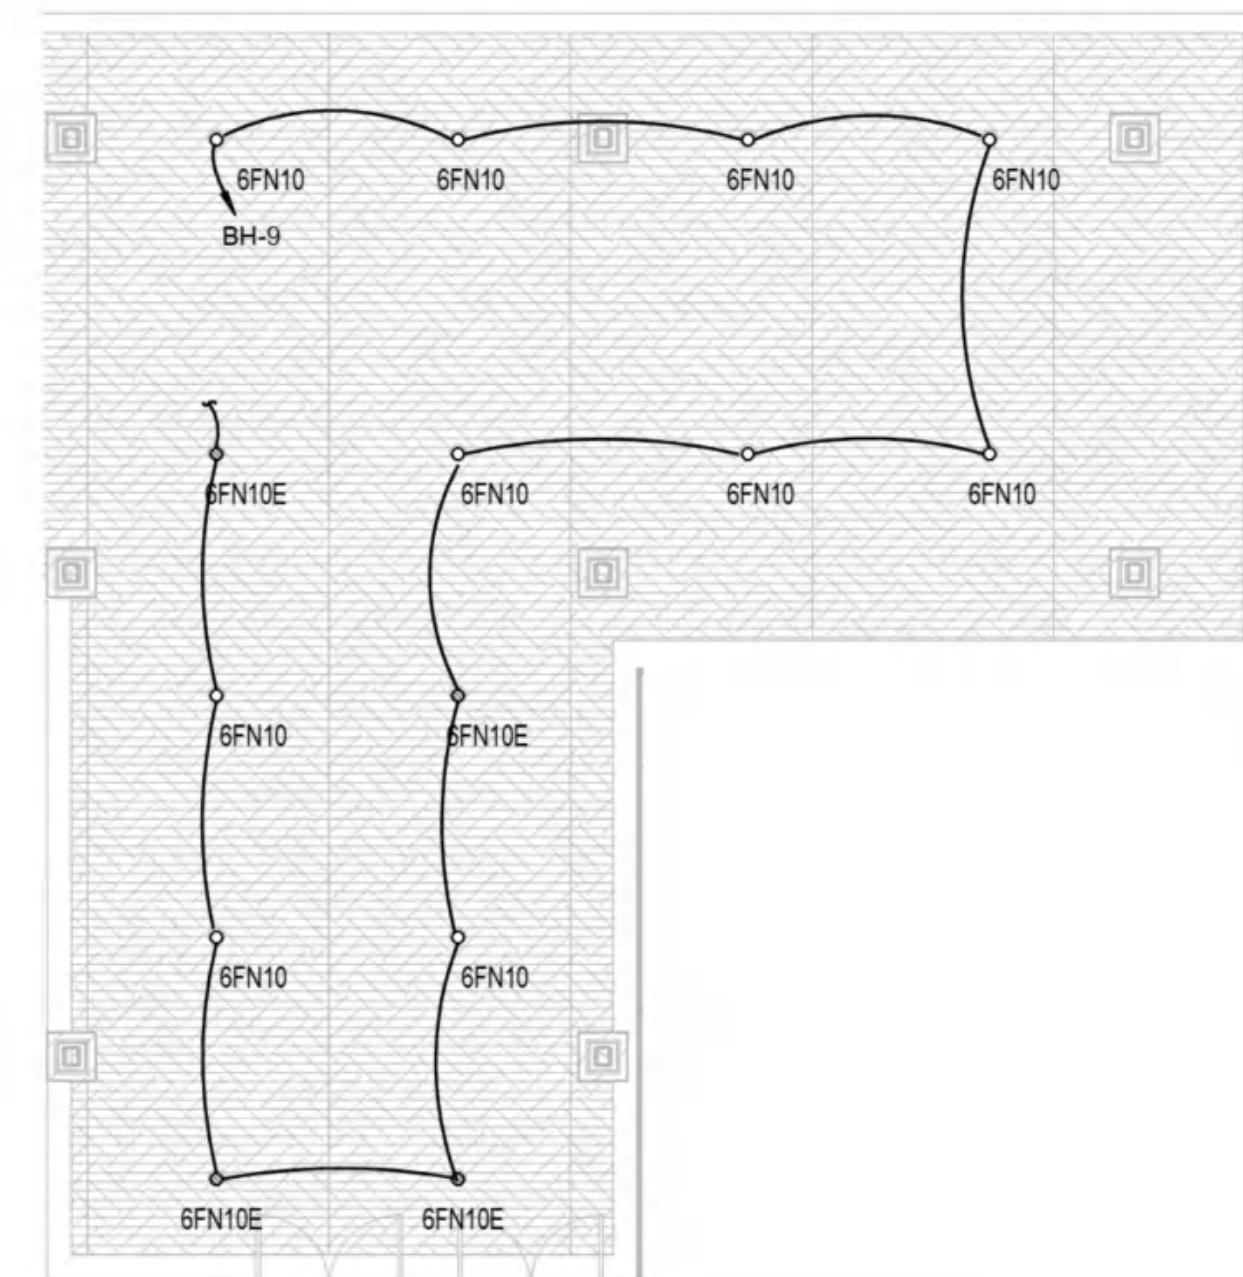

2 LIGHTING CEILING PLAN - LEVEL ONE - SEGMENT A - EXTERIOR CANOPY
1/8" = 1'-0"



LIGHTING GENERAL NOTES

1. SEE SHEET EL07-01 FOR GENERAL NOTES APPLICABLE TO THE ENTIRE DRAWING SET.
2. REFER TO LIGHTING CONTROL CHART FOR MORE INFORMATION ON LIGHTING CONTROL SWITCH PLAN NOTES (CIRCLE NOTES - LE, LC, ETC.)

LIGHTING PLAN NOTES

- | | |
|-----|---|
| L1 | INSTALL BOTTOM OF LUMINAIRE AT 10'-6" A.F.F. VERIFY EXACT INSTALLATION HEIGHT WITH ARCHITECT BEFORE INSTALLATION. |
| L2 | INSTALL BOTTOM OF LUMINAIRES IN THIS SPACE AT 9'-0" A.F.F. INSTALL LUMINAIRES TO AVOID MECHANICAL EQUIPMENT. |
| L3 | INSTALL LIGHTING DEVICE ON MULLION. WIRING FOR DEVICE TO BE RUN IN MULLION. |
| L11 | RECESSED LUMINAIRES IN ALL SPECIALTY CEILINGS SHALL BE INDEPENDENTLY SUPPORTED FROM STRUCTURE. |
| L12 | SWITCH(ES) AT THIS LOCATION TO OPERATE AS THREE-WAY SWITCH(ES). |
| L13 | SWITCH(ES) AT THIS LOCATION TO OPERATE AS FOUR-WAY SWITCH(ES). |

1 LIGHTING CEILING PLAN - LEVEL ONE - SEGMENT B
1/8" = 1'-0"

● Count

● Switch 49EA ● Motion Sensor 45EA ■ Photocell 12EA

1. SEE SHEET EL07-01 FOR GENERAL NOTES APPLICABLE TO THE ENTIRE DRAWING SET.
2. REFER TO LIGHTING CONTROL CHART FOR MORE INFORMATION ON LIGHTING CONTROL SWITCH PLAN NOTES (CIRCLE NOTES - LE, LC, ETC.)

L1 INSTALL BOTTOM OF LUMINAIRE AT 10'-0" A.F.F. VERIFY EXACT
INSTALLATION HEIGHT WITH ARCHITECT BEFORE INSTALLATION.

L2 INSTALL BOTTOM OF LUMINAIRES IN THIS SPACE AT 9'-0" A.F.F.
INSTALL LUMINAIRES TO AVOID MECHANICAL EQUIPMENT.

L3 INSTALL LIGHTING DEVICE ON MULLION. WIRING FOR DEVICE TO
BE RUN IN MULLION.

L11 RECESSED LUMINAIRES IN ALL SPECIALTY CEILINGS SHALL BE
INDEPENDENTLY SUPPORTED FROM STRUCTURE.

L12 SWITCH(ES) AT THIS LOCATION TO OPERATE AS THREE-WAY
SWITCH(ES).

L13 SWITCH(ES) AT THIS LOCATION TO OPERATE AS FOUR-WAY
SWITCH(ES).



- Switch

- Motion Sensor

 Photocell

8EA




1 LIGHTING CEILING PLAN - LEVEL ONE - SEGMENT D
1/8" = 1'-0"

LIGHTING GENERAL NOTES


1. SEE SHEET EL07-01 FOR GENERAL NOTES APPLICABLE TO THE ENTIRE DRAWING SET.
2. REFER TO LIGHTING CONTROL CHART FOR MORE INFORMATION ON LIGHTING CONTROL SWITCH PLAN NOTES (CIRCLE NOTES - LE, LC, ETC.)

LIGHTING PLAN NOTES

- L1 INSTALL BOTTOM OF LUMINAIRE AT 10'-6" A.F.F. VERIFY EXACT INSTALLATION HEIGHT WITH ARCHITECT BEFORE INSTALLATION.
- L2 INSTALL BOTTOM OF LUMINAIRE IN THIS SPACE AT 9'-0" A.F.F. INSTALL LUMINAIRE TO AVOID MECHANICAL EQUIPMENT.
- L7 INSTALL BOTTOM OF LUMINAIRE IN THIS SPACE AT 23'-0" A.F.F. INSTALL LUMINAIRE TO AVOID MECHANICAL EQUIPMENT.
- L11 RECESSED LUMINAIRE IN ALL SPECIALTY CEILINGS SHALL BE INDEPENDANTLY SUPPORTED FROM STRUCTURE.
- L12 SWITCH(ES) AT THIS LOCATION TO OPERATE AS THREE-WAY SWITCH(ES).
- L16 SWITCH TO CONTROL LUMINAIRE(S) IN MEZZANINE ABOVE. LABEL SWITCH "MEZZANINE LIGHTING".

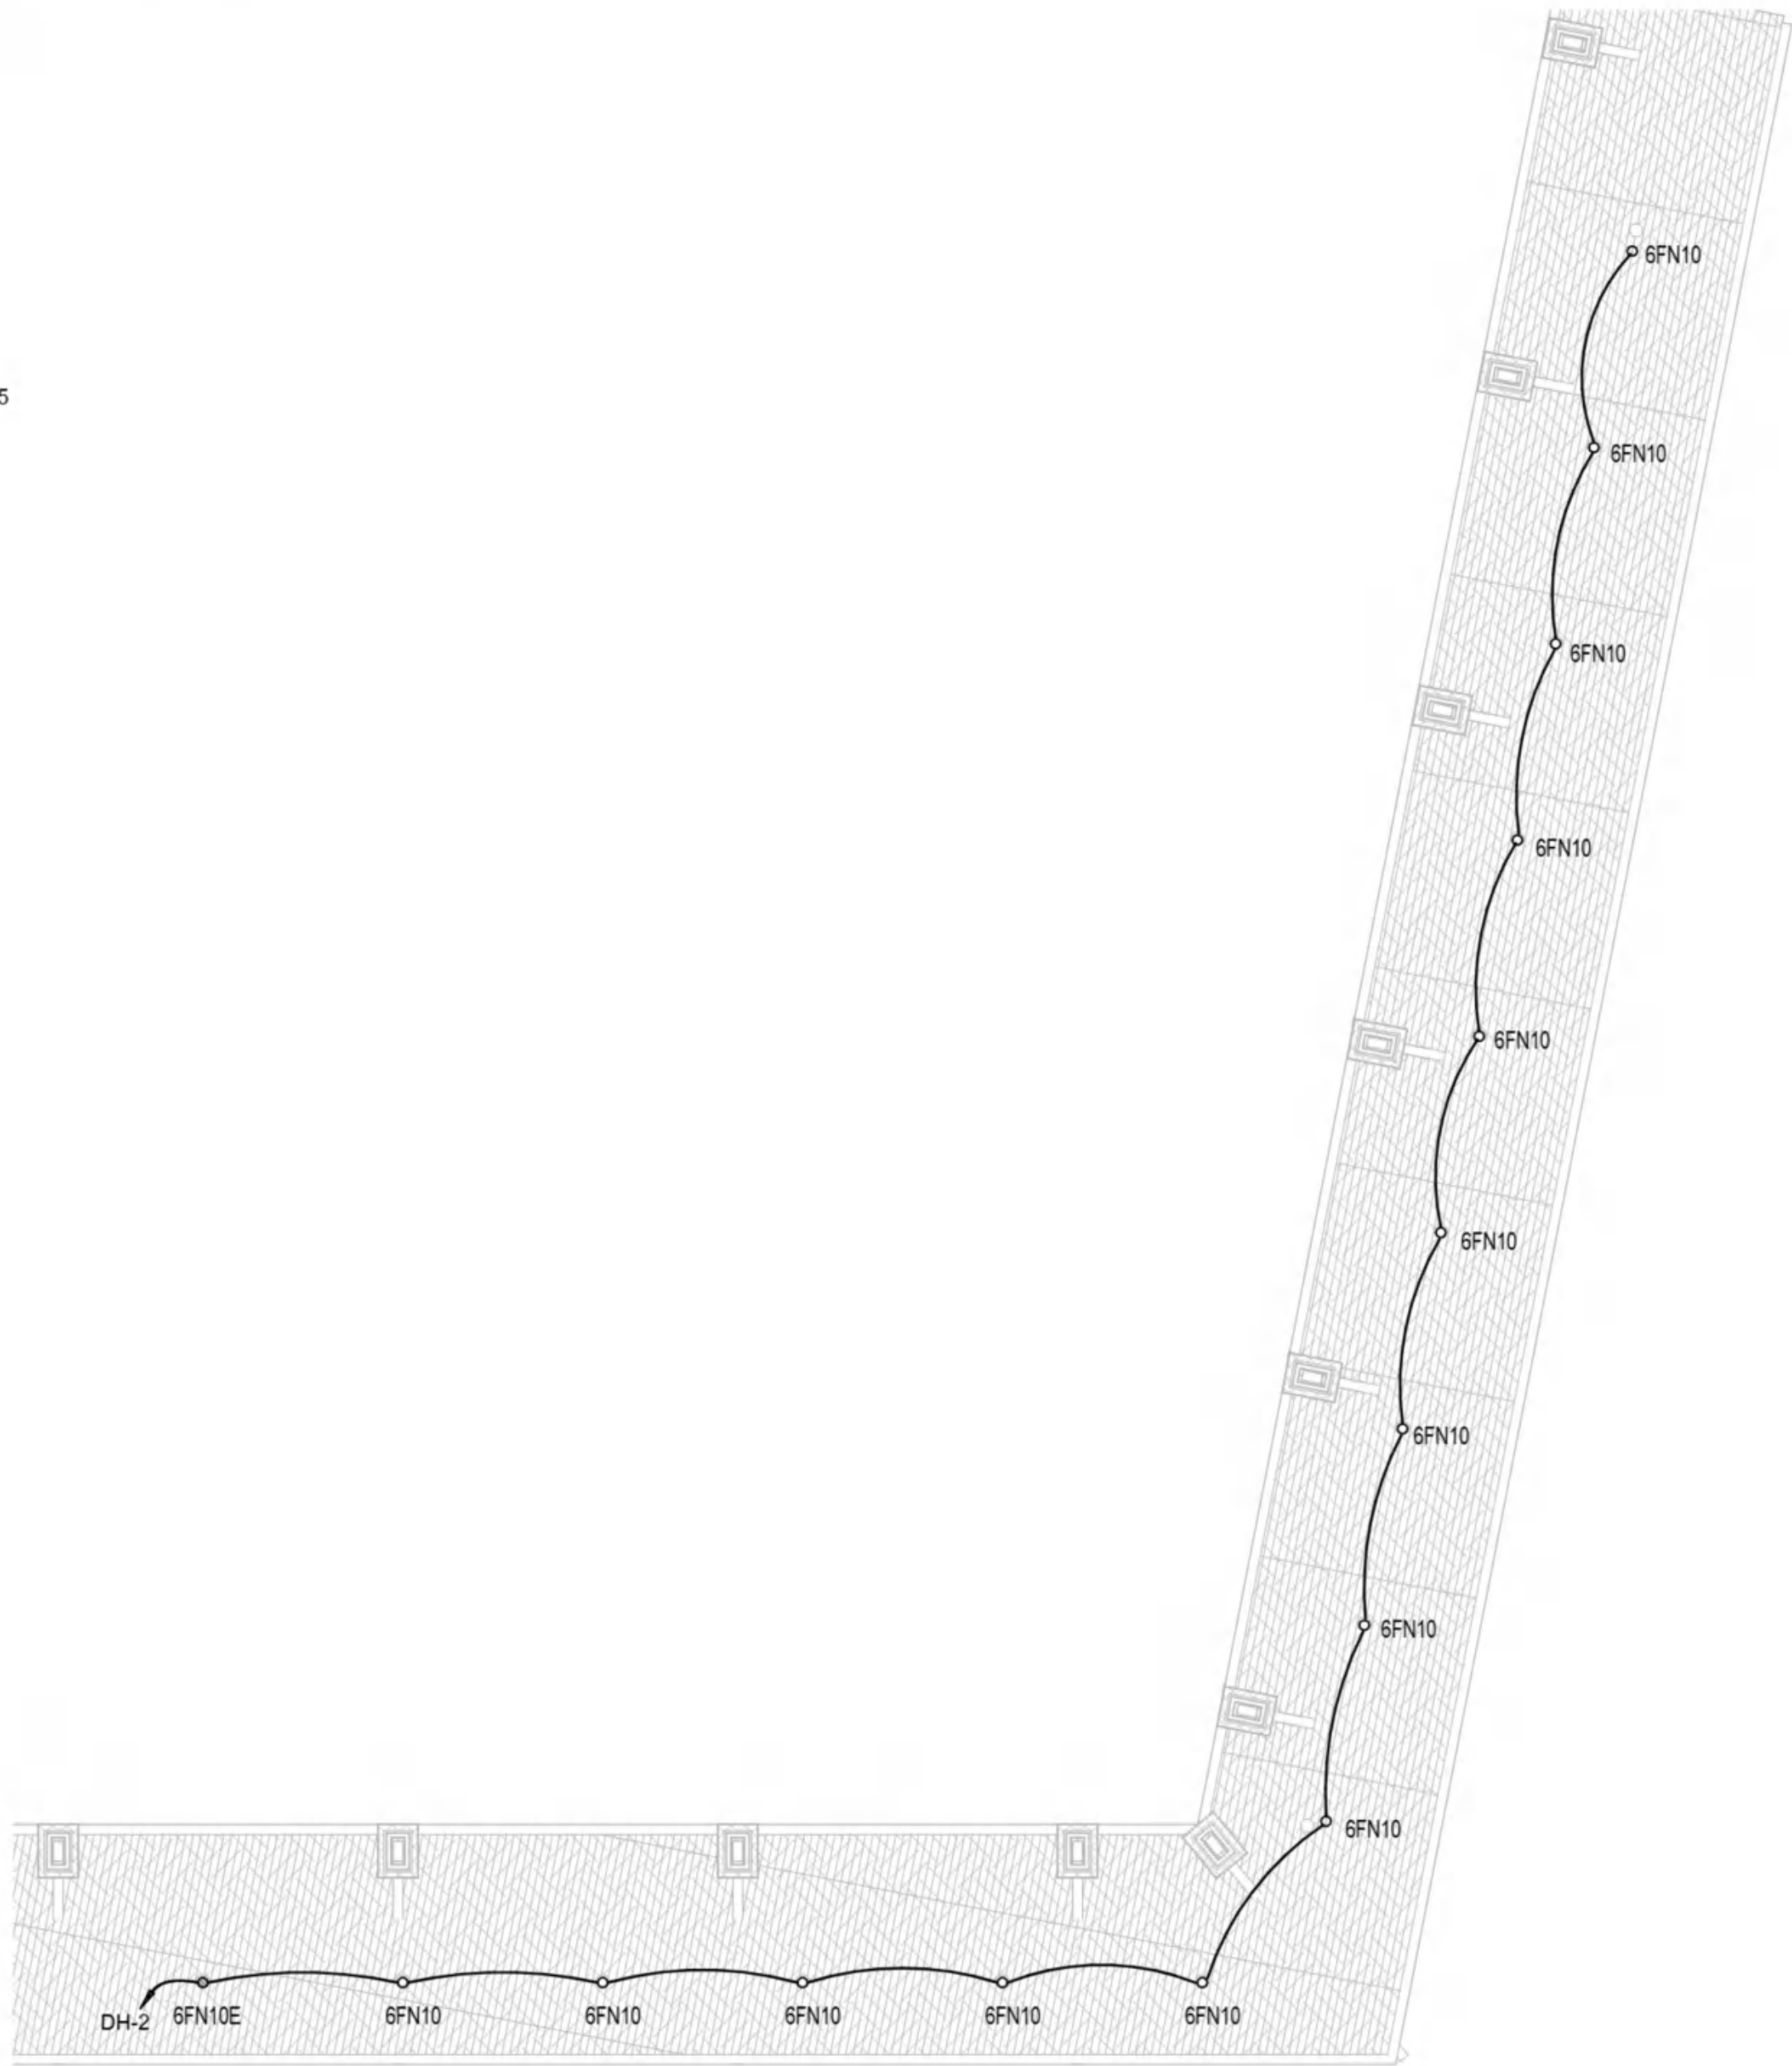

3 LIGHTING CEILING PLAN - LEVEL ONE - WEST CANOPY
1/8" = 1'-0"

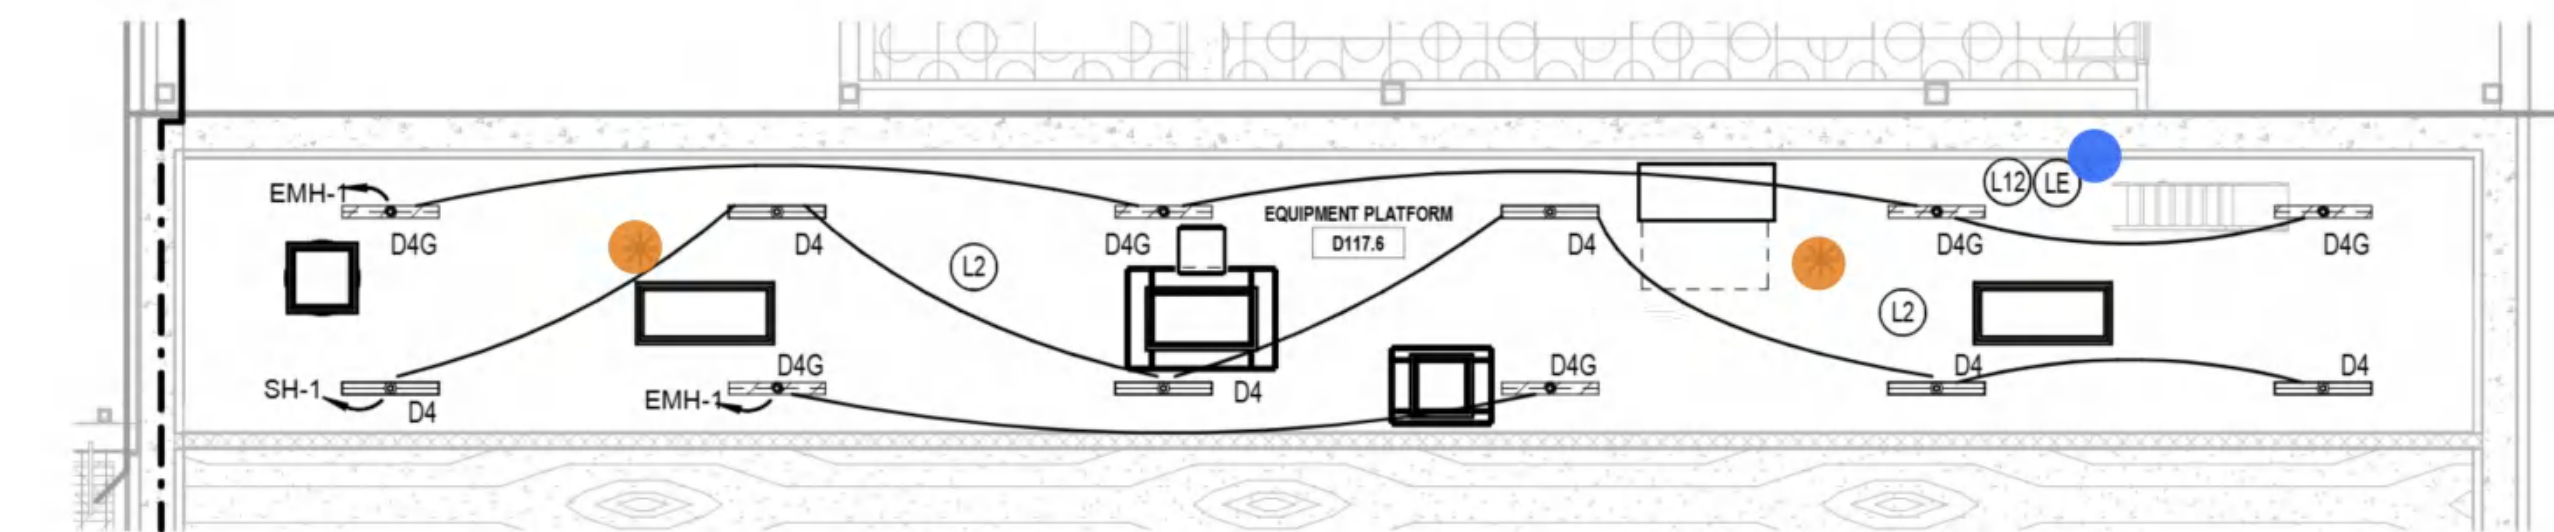

2 LIGHTING CEILING PLAN - LEVEL TWO - EQUIPMENT PLATFORM
1/8" = 1'-0"